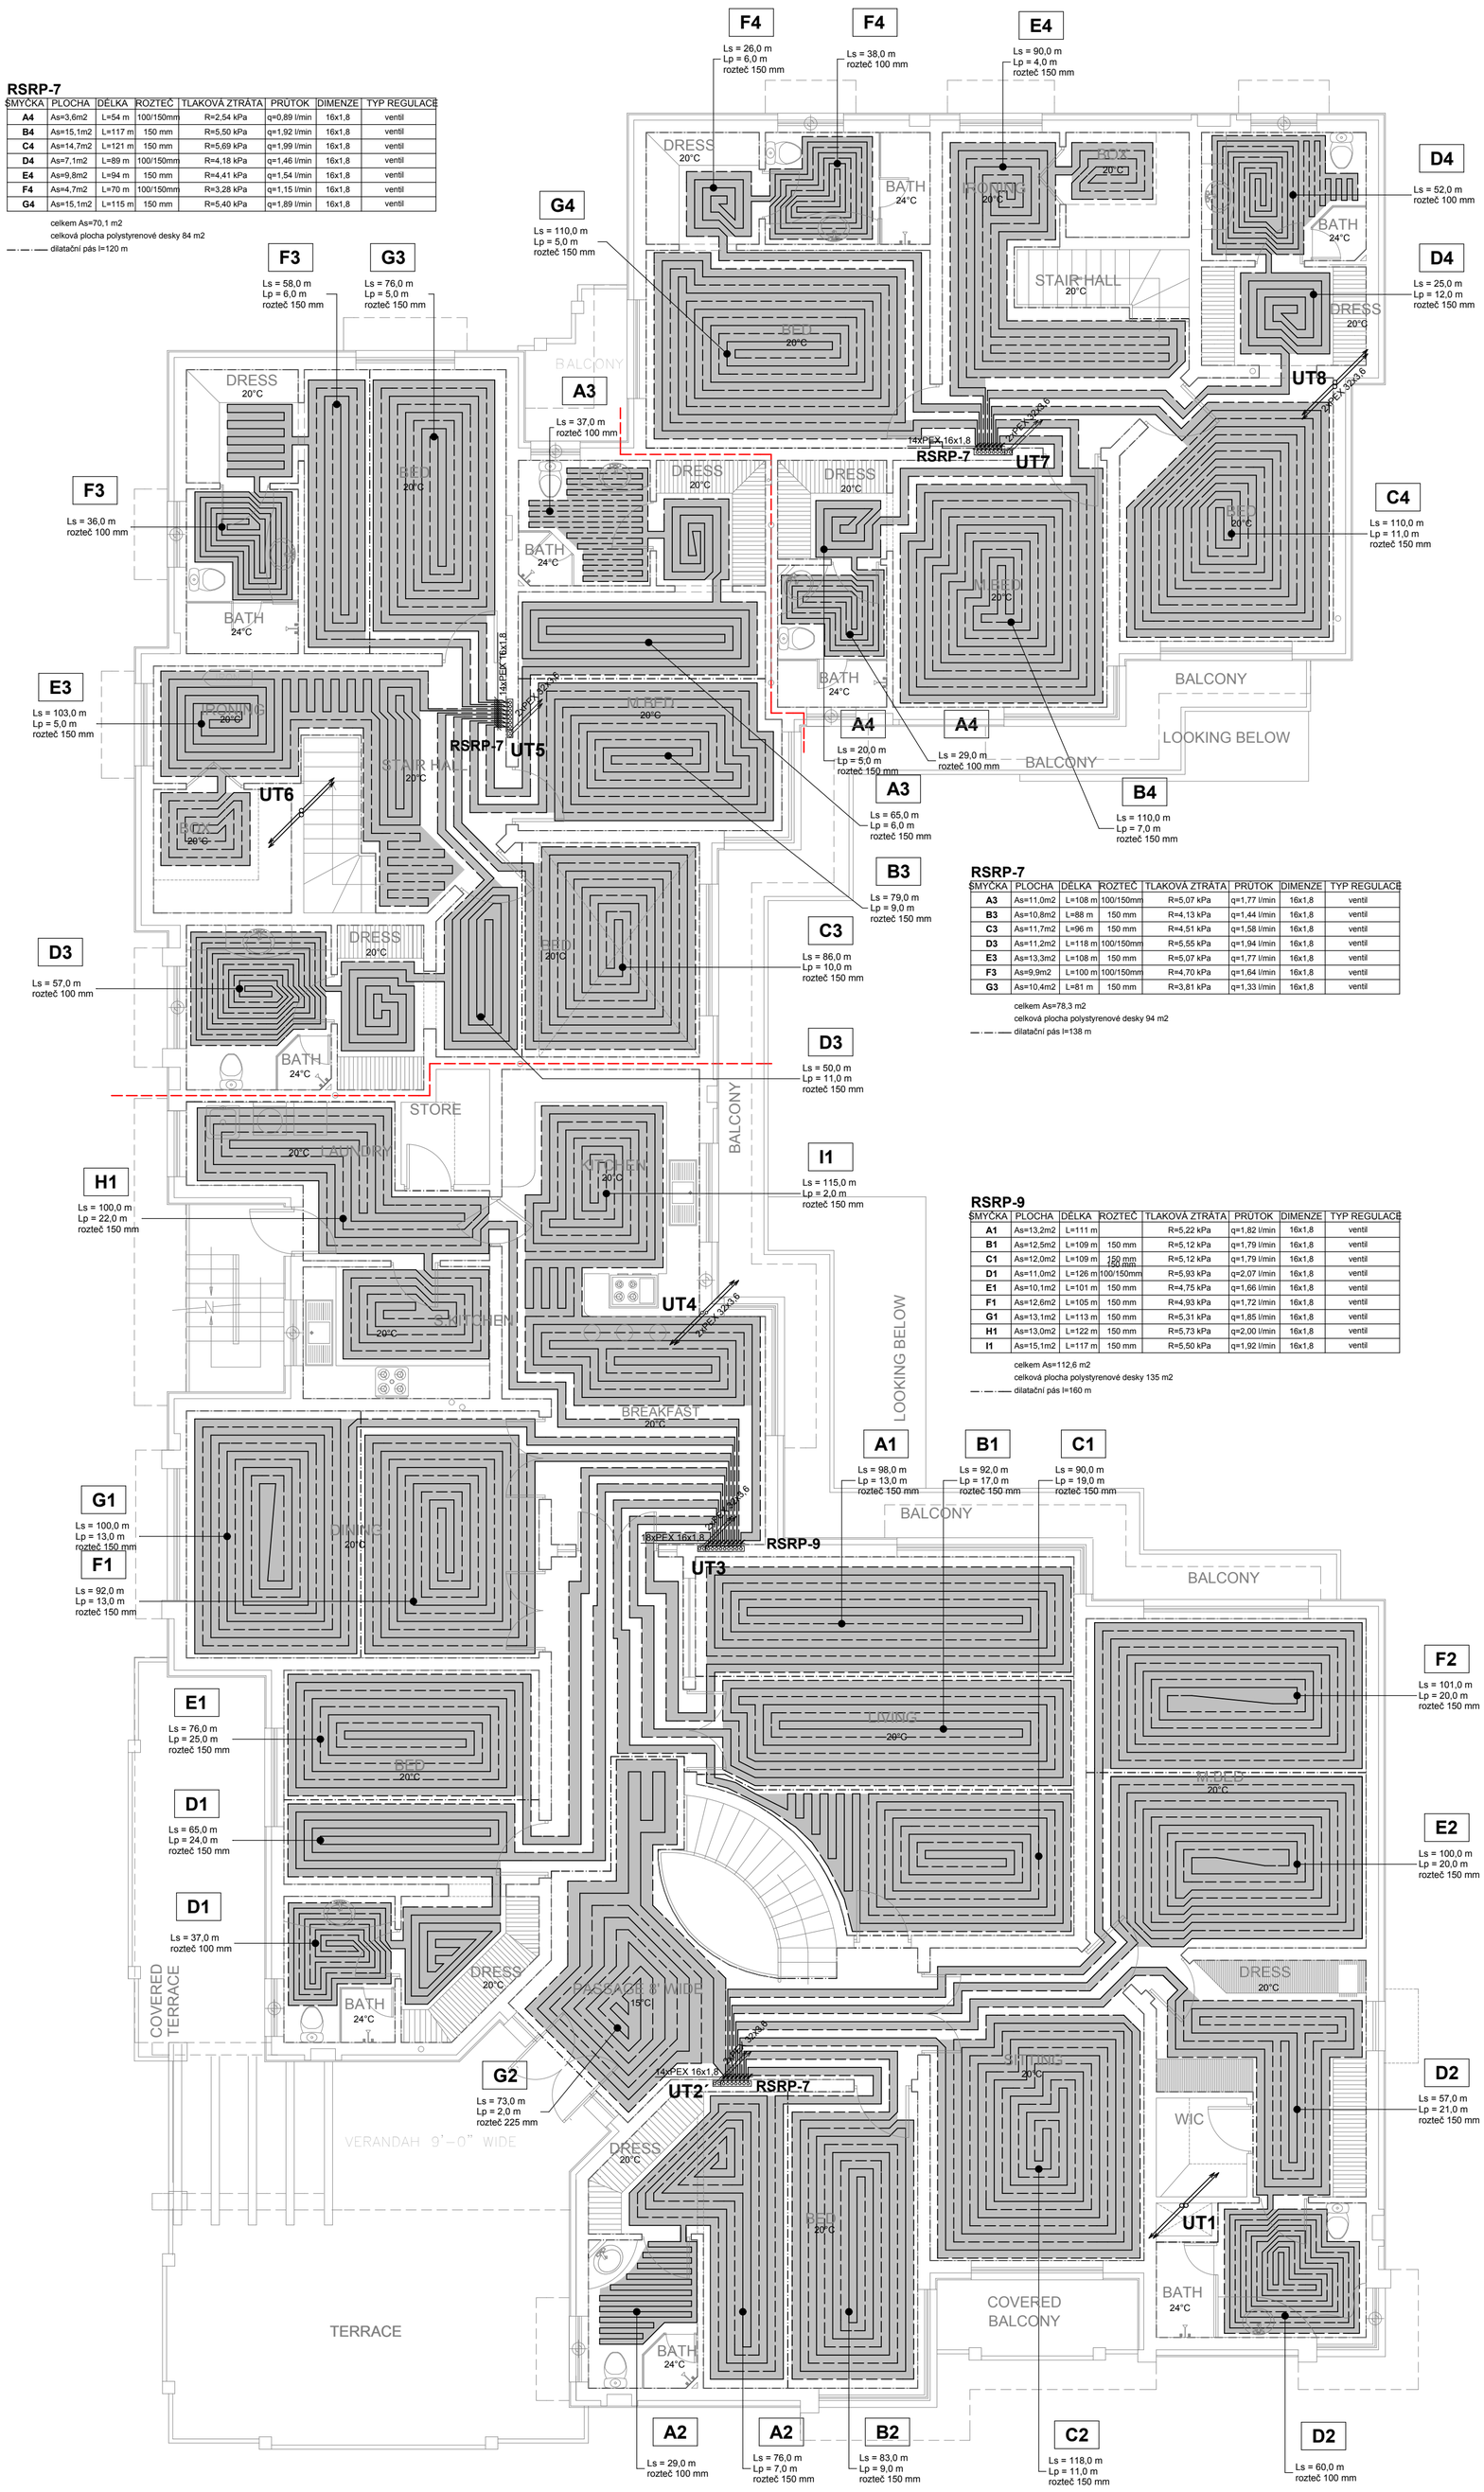

RSRP-7

ŠMYČKA	PLOCHA	DÉLKA	ROZTEČ	TLAKOVÁ ZTRÁTA	PRŮTOK	DIMENZE	TYP REGULACE
A4	As=3,6m2	L=54 m	100/150mm	R=2,54 kPa	q=0,89 l/min	16x1,8	ventil
B4	As=15,1m2	L=117 m	150 mm	R=5,50 kPa	q=1,92 l/min	16x1,8	ventil
C4	As=14,7m2	L=121 m	150 mm	R=5,69 kPa	q=1,99 l/min	16x1,8	ventil
D4	As=7,1m2	L=89 m	100/150mm	R=4,18 kPa	q=1,46 l/min	16x1,8	ventil
E4	As=9,8m2	L=94 m	150 mm	R=4,41 kPa	q=1,54 l/min	16x1,8	ventil
F4	As=4,7m2	L=70 m	100/150mm	R=3,28 kPa	q=1,15 l/min	16x1,8	ventil
G4	As=15,1m2	L=115 m	150 mm	R=5,40 kPa	q=1,89 l/min	16x1,8	ventil

celkem As=70,1 m2
celková plocha polystyrenové desky 84 m2
dilatační pás l=120 m

RSRP-7

ŠMYČKA	PLOCHA	DÉLKA	ROZTEČ	TLAKOVÁ ZTRÁTA	PRŮTOK	DIMENZE	TYP REGULACE
A3	As=11,0m2	L=108 m	100/150mm	R=5,07 kPa	q=1,77 l/min	16x1,8	ventil
B3	As=10,8m2	L=88 m	150 mm	R=4,13 kPa	q=1,44 l/min	16x1,8	ventil
C3	As=11,7m2	L=96 m	150 mm	R=4,51 kPa	q=1,58 l/min	16x1,8	ventil
D3	As=11,2m2	L=118 m	100/150mm	R=5,55 kPa	q=1,94 l/min	16x1,8	ventil
E3	As=13,3m2	L=108 m	150 mm	R=5,07 kPa	q=1,77 l/min	16x1,8	ventil
F3	As=9,9m2	L=100 m	100/150mm	R=4,70 kPa	q=1,64 l/min	16x1,8	ventil
G3	As=10,4m2	L=81 m	150 mm	R=3,81 kPa	q=1,33 l/min	16x1,8	ventil

celkem As=78,3 m2
celková plocha polystyrenové desky 94 m2
dilatační pás l=138 m

RSRP-9

ŠMYČKA	PLOCHA	DÉLKA	ROZTEČ	TLAKOVÁ ZTRÁTA	PRŮTOK	DIMENZE	TYP REGULACE
A1	As=13,2m2	L=111 m		R=5,22 kPa	q=1,82 l/min	16x1,8	ventil
B1	As=12,5m2	L=109 m	150 mm	R=5,12 kPa	q=1,79 l/min	16x1,8	ventil
C1	As=12,0m2	L=109 m	150 mm	R=5,12 kPa	q=1,79 l/min	16x1,8	ventil
D1	As=11,0m2	L=126 m	100/150mm	R=5,93 kPa	q=2,07 l/min	16x1,8	ventil
E1	As=10,1m2	L=101 m	150 mm	R=4,75 kPa	q=1,66 l/min	16x1,8	ventil
F1	As=12,6m2	L=105 m	150 mm	R=4,93 kPa	q=1,72 l/min	16x1,8	ventil
G1	As=13,1m2	L=113 m	150 mm	R=5,31 kPa	q=1,85 l/min	16x1,8	ventil
H1	As=13,0m2	L=122 m	150 mm	R=5,73 kPa	q=2,00 l/min	16x1,8	ventil
I1	As=15,1m2	L=117 m	150 mm	R=5,50 kPa	q=1,92 l/min	16x1,8	ventil

celkem As=112,6 m2
celková plocha polystyrenové desky 135 m2
dilatační pás l=160 m

RSRP-7

ŠMYČKA	PLOCHA	DÉLKA	ROZTEČ	TLAKOVÁ ZTRÁTA	PRŮTOK	DIMENZE	TYP REGULACE
A2	As=11,6m2	L=112 m	100/150mm	R=5,26 kPa	q=1,84 l/min	16x1,8	ventil
B2	As=11,2m2	L=92 m	150 mm	R=4,32 kPa	q=1,51 l/min	16x1,8	ventil
C2	As=16,4m2	L=129 m	150 mm	R=6,06 kPa	q=2,11 l/min	16x1,8	ventil
D2	As=12,7m2	L=138 m	100/150mm	R=6,48 kPa	q=2,26 l/min	16x1,8	ventil
E2	As=14,1m2	L=120 m	150 mm	R=5,64 kPa	q=1,97 l/min	16x1,8	ventil
F2	As=13,4m2	L=121 m	150 mm	R=5,69 kPa	q=1,99 l/min	16x1,8	ventil
G2	As=12,0m2	L=75 m	225 mm	R=3,52 kPa	q=1,23 l/min	16x1,8	ventil

celkem As=91,4 m2
celková plocha polystyrenové desky 110 m2
dilatační pás l=131 m

Zodpovědný projektant:	Ing. Zdeněk Jícha	Revai stavebně obchodně a montážní společnost, Příbram I, Evropská 127, tel: 318628697, 318620904, IČO: 47 54 38 50
Vypracoval:	Ing. Jaroslava Kučerová	
Investor:		
Kraj:	Kat.území:	
Akce: *PROPOSED FARM HOUSE FOR MR. MUHAMMAD TAHIR PLOT NO. 21 ,HELUM BLOCK GREEN FORTS 2, MULTAN ROAD. LAHORE.*	Formát: A4	Číslo paré
	Datum: 03.2011	
	Stupeň:	
	Profese: Vytápění	
	Číslo zakázky:	
Obsah: *Půdorys 1.NP-vytápění*	Měřítko: 1:75	Výkres č.: 2

FIRST FLOOR PLAN

Abrar A. Siddiqui & Associates
Architects - Engineers - Planners
10-S GULBERG CENTRE, MAIN BOULEVARD,
GULBERG III
Phone- +92-42-5874725, 5873023. FAX: 5715112

PROJECT	TITLE	REV. NO.	DESCRIPTION	DATE	ARCHITECT	DRAWN BY	DRAWING No.	COVERED AREA
	PROPOSED FIRST FLOOR PLAN	01	PLAN CHANGED	21/1/11	ABRAR A. SIDDIQUI	M.MAZHAR		
		02	LOCATION OF CHASEWALL CHANGE	11/2/11				
	CLIENT				ARCHITECTURAL ENGINEER	DATE	SCALE	PROJECT No.
	Mr. MUHAMMAD TAHIR				SAHMILA NAZ	APR. 23, 2011	NTS.	